


All joints shall be mechanical type with retainer glands

Where hydrant base is in or near water table, the drain port shall be plugged and tag furnished and placed on the hydrant.



Contractor shall rotate tee and provide bends as necessary to maintain minimum 8' cover on hydrant lead and a vertical hydrant installation or may install a offset fitting.

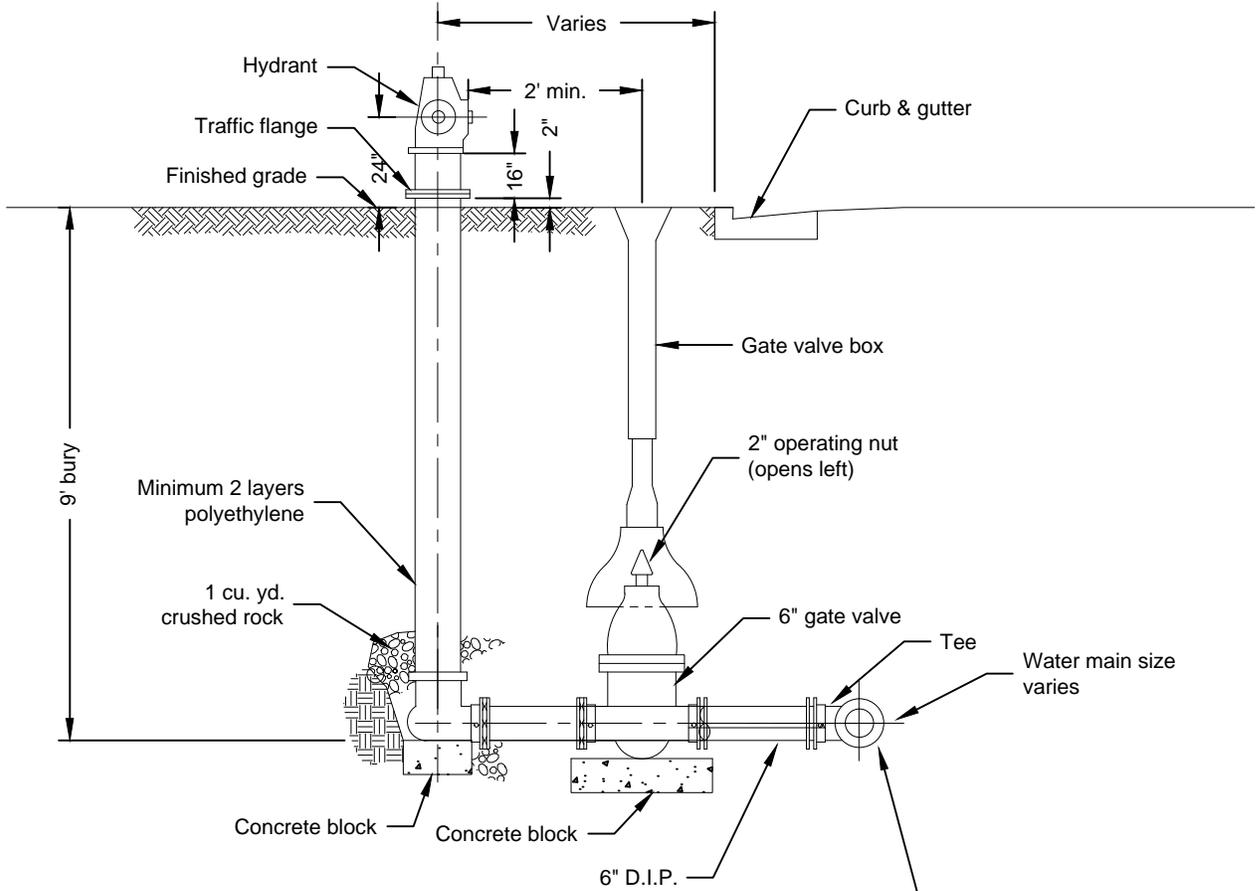

Fire Hydrant

Date Revised August 2014
Plate Number 3310-04
Sheet 1 of 1

